




DUCTWORK				
A	B	C	D	QTY.
10"	10"	12"	1"	2





CURBPLATE		
WIDTH	LENG.	QTY.
18"	18"	2

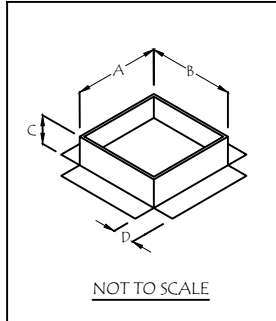


FAN MODEL	A	B	C	D	QTY
20D	17 1/2"	17 1/2"	2"	4"	2

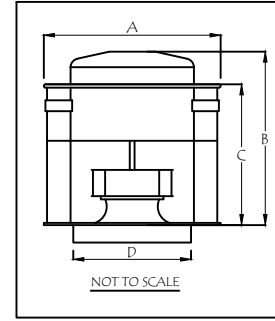

FAN MODEL	A	B	C	D	QTY	WT. LBS.
20D	26 3/4"	19 1/2"	16 3/4"	19" SQ.	2	60 LBS.

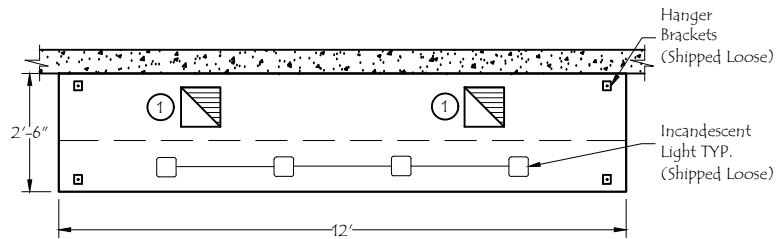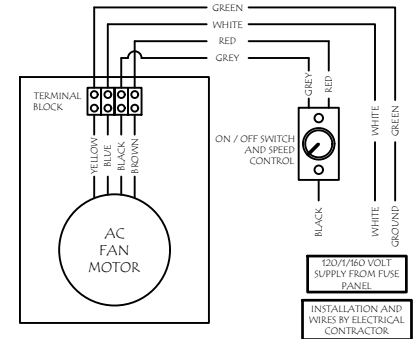

PLAN VIEW
SCALE: 3/8"=1'-0"

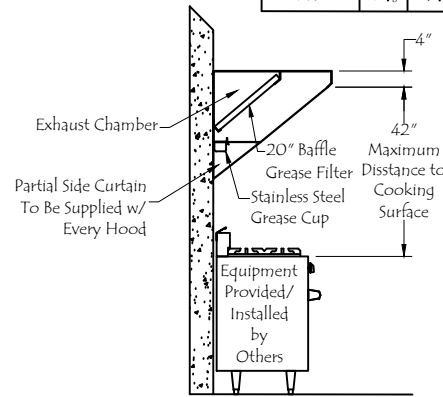

SIDE VIEW
SCALE: 3/8"=1'-0"

"IT IS THE RESPONSIBILITY OF THE ARCHITECT/OWNER TO ENSURE THAT THE HOOD CLEARANCE FROM LIMITED-COMBUSTIBLE MATERIALS IS IN COMPLIANCE WITH LOCAL CODE REQUIREMENTS"

ALL EQUIPMENT IS UL LISTED COMPONENTS

HOODMART HOODS ARE BUILT IN COMPLIANCE WITH : NFPA #96 & UL710

AND ARE RECOGNIZED BY ONE OR MORE OF THE FOLLOWING: - NSF INTERNATIONAL - UL



HOOD NO.	MODEL	LENGTH	MAX. COOKING TEMP.	① EXHAUST PLENUM						② SUPPLY PLENUM						HOOD CONSTRUCTION
				TOTAL EXH. CFM	RISER(S)					TOTAL SUP. CFM	RISER(S)					
					WIDTH	LENG.	QTY.	CFM	S.P.		WIDTH	LENG.	QTY.	CFM	S.P.	
1	EXSS012C 12X30	144" NOM 144" OD	700 Deg.	2400	10"	10"	2	1200	.375"	-	-	-	-	-	-	STAINLESS STEEL
HOOD NO.	FILTER(S)				LIGHT(S)				UTILITY CABINET(S)							
	TYPE	QTY.	HEIGHT	LENGTH	TYPE	QTY.	WIRE GUARD	FIRE SYSTEM				ELECTRICAL		QUANTITY		
								TYPE		SIZE		MODEL #				
1	S.S. BAFFLE W/ HANDLES	4	20"	16"	INCANDESCENT LIGHT	4	NO	--		--		--				
		4	20"	20"												
FAN UNIT NO.	FAN UNIT MODEL #	EXHAUST FAN									SUPPLY FAN					
		MODEL	TAG	CFM	S.P.	RPM	H.P.	Ø	VOLT	FLA	BLOWER	HOUSING	TAG	CFM	S.P.	
1	20D EF-1	20D	EF-1	1200	.375"	1680	1/4	1	115	2.6						
2	20D EF-2	20D	EF-2	1200	.375"	1680	1/4	1	115	2.6						

REVISIONS					172 READER COURT ELYRIA, OHIO 44035 TOLL FREE: 1-800-755-6264 FAX: 1-800-755-6264 EQUIPMENT SCHEDULE CONCESSION CANOPY CONTRACT NO. - ITEM NO. - JOB: - LOC: - CUST: - CUST#:-
REV	DATE	BY	BY	REMARKS	
8	4/21/20	TEAM	-	CHANGE FAN TYPE AND QTY. ADD DUCT	
DATE: _____ SCALE: AS NOTED					DWG# 11917
DRAWN BY: _____ APPROVED BY: _____					
					SHT - OF -

DWG#11917

SHT -
OF -